


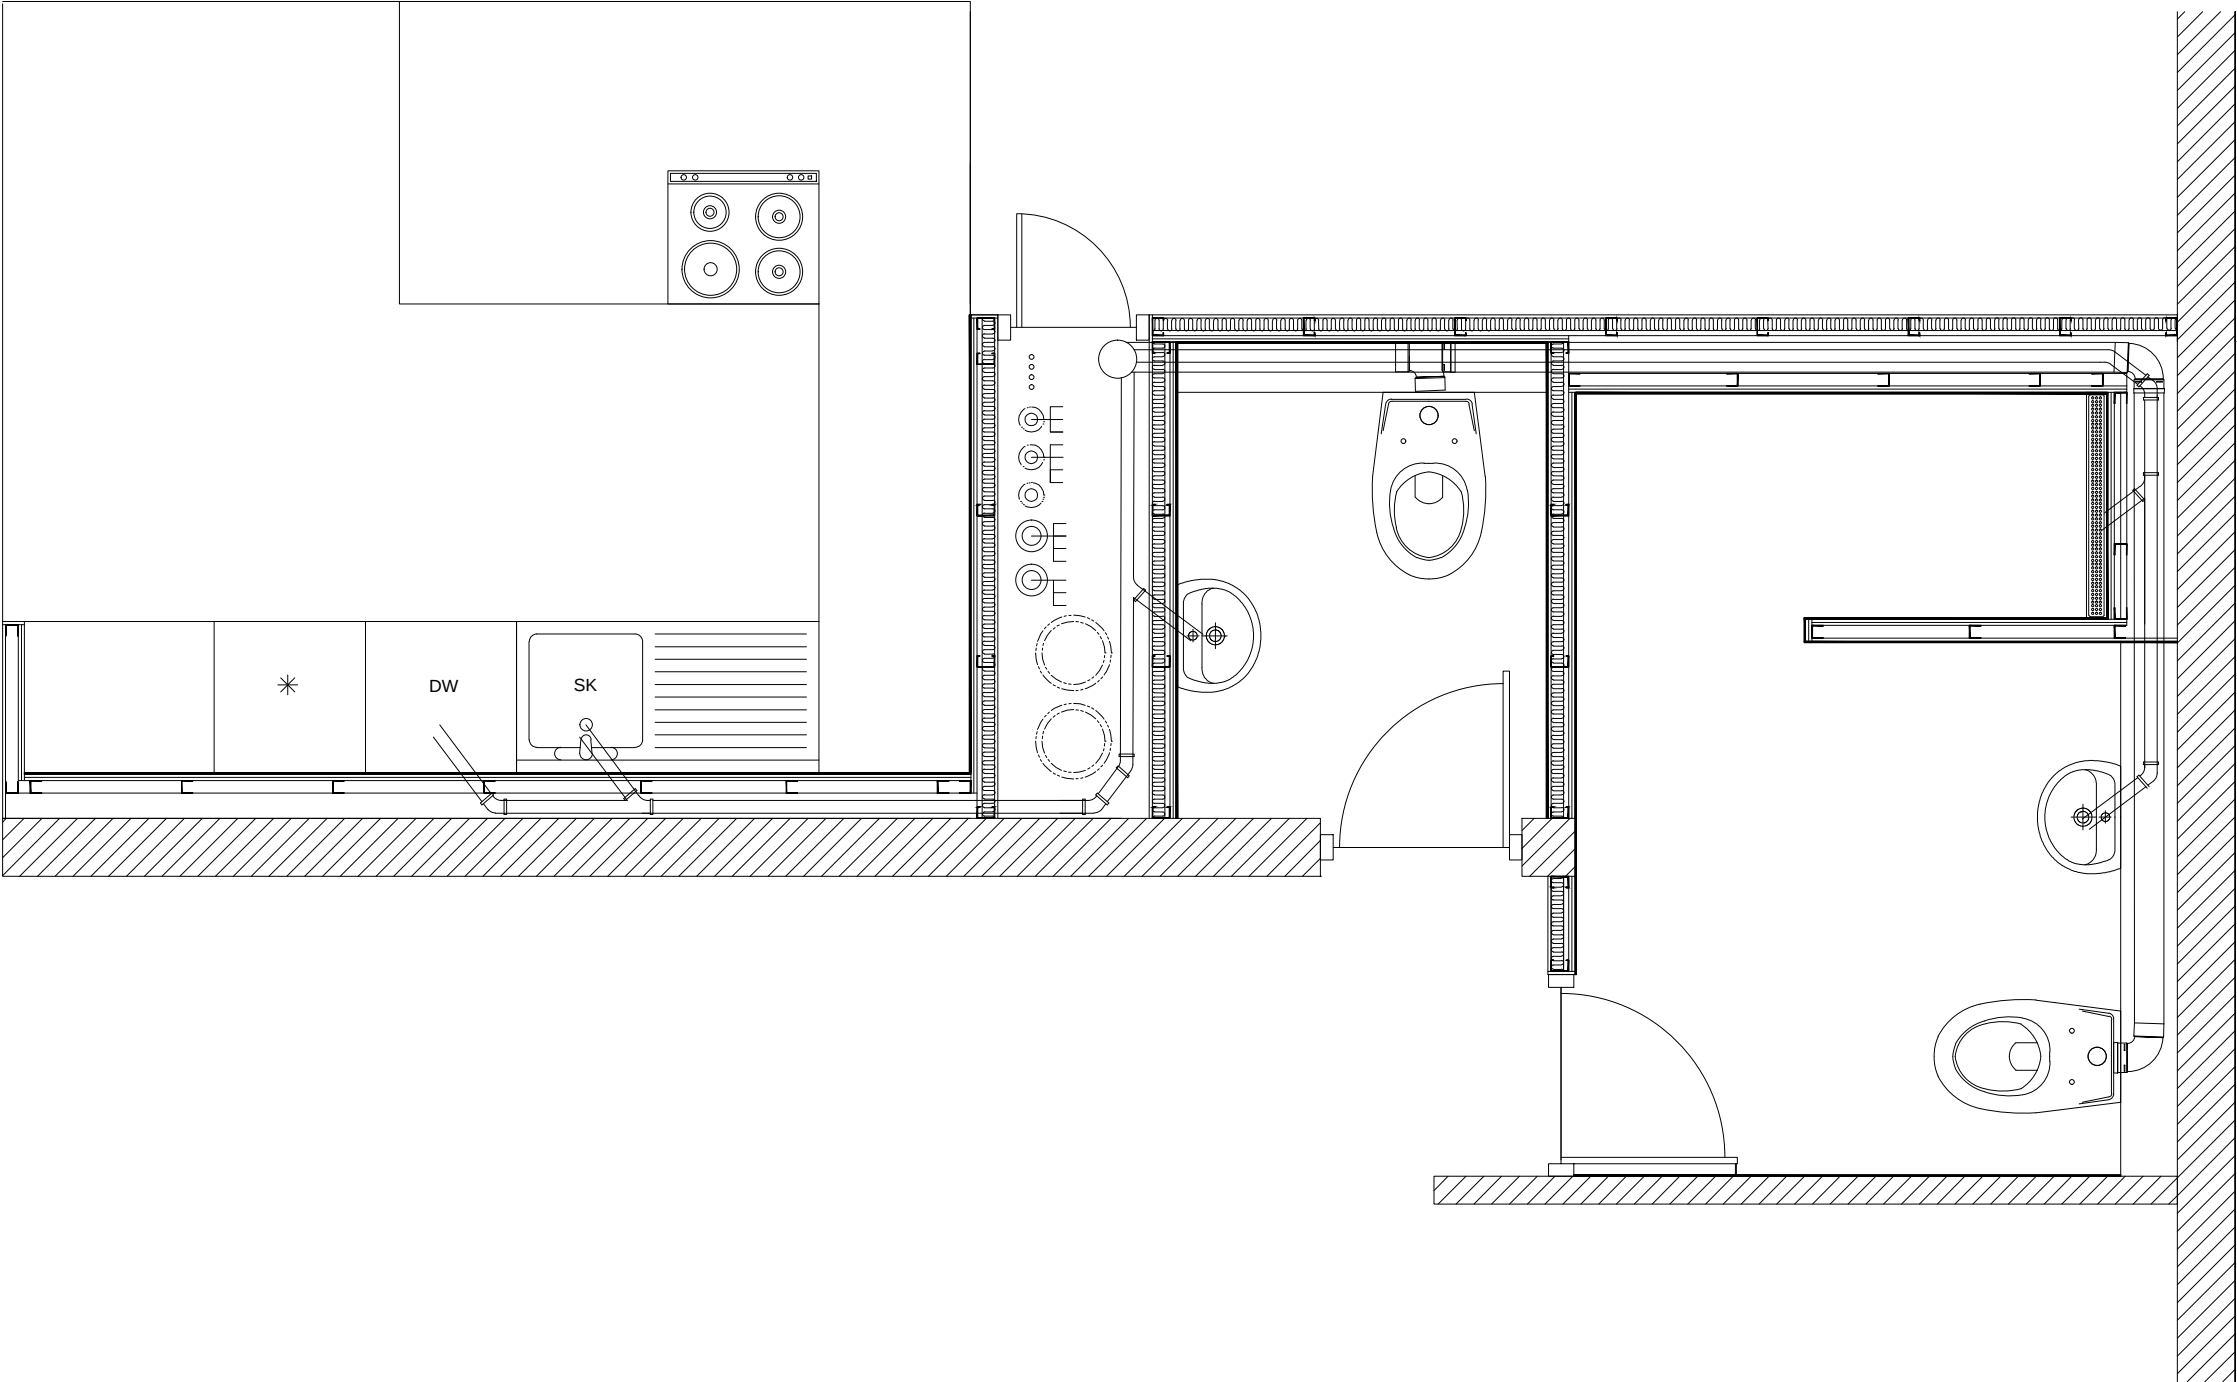

NOTES

Sewage

Sewers are made of PVC pipes. Sewer Division has a diameter of 150mm. Connection of individual devices directly to the vertical drainage through the knee, or another device are adapted to one tube, and finally included in the installation.

Waste pipe from the toilet needs to be led to the shaft with the slope minimum 2‰, size of the pipe should be minimum 110mm, attention should be paid especially in the pipe bending
3.2 Our solution Gypsum walls on 50mm aluminum studs with cavity space of 150mm between studs and existing brick wall makes the space to fit installations for the sewer, drain and supply of hot and cold water. In the bending of the sewer pipe wall has a gap of 200mm allowing to passing the bending through

Project name and address		Description	Scale
BALCONY STEEL FRAME			1:10
5th Semester project Moldevej 29-39 Vejle			
	Project No	Revision	
	Drawing type	Revision number	
	Designer	Drawn by AGNIESZKA KRASUSKA	