

Document downloaded from:

<http://hdl.handle.net/10251/125199>

This paper must be cited as:

Salcedo-Romero-De-Ávila, J.; Martínez Iranzo, MA.; Ramos Fernández, C.; Herrero Durá, JM. (2007). Predictive LPV control of a liquid-gas separation process. *Advances in Engineering Software*. 38(7):466-474. <https://doi.org/10.1016/j.advengsoft.2006.10.003>



The final publication is available at

<http://doi.org/10.1016/j.advengsoft.2006.10.003>

Copyright Elsevier

Additional Information


Provided for non-commercial research and educational use only.
Not for reproduction or distribution or commercial use.



VOL. 38, NO. 7, JULY 2007

ISSN 0965-9978

A D V A N C E S I N E N G I N E E R I N G S O F T W A R E

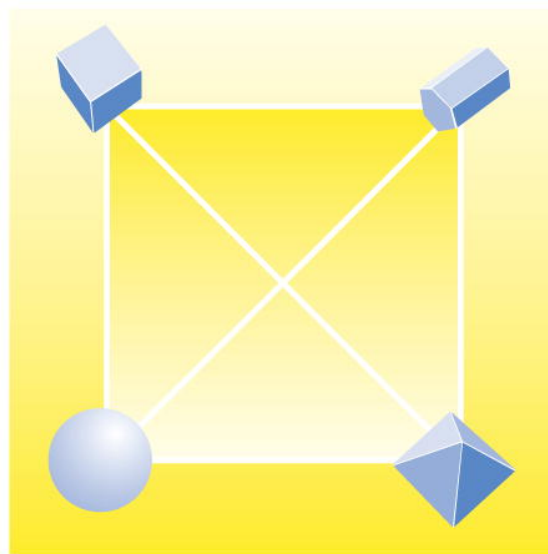

This article was originally published in a journal published by Elsevier, and the attached copy is provided by Elsevier for the author's benefit and for the benefit of the author's institution, for non-commercial research and educational use including without limitation use in instruction at your institution, sending it to specific colleagues that you know, and providing a copy to your institution's administrator.

All other uses, reproduction and distribution, including without limitation commercial reprints, selling or licensing copies or access, or posting on open internet sites, your personal or institution's website or repository, are prohibited. For exceptions, permission may be sought for such use through Elsevier's permissions site at:

<http://www.elsevier.com/locate/permissionusematerial>

Predictive LPV control of a liquid–gas separation process ^{☆,☆☆}

J.V. Salcedo ^{*}, M. Martínez, C. Ramos, J.M. Herrero

Department of Systems Engineering and Control, Universidad Politécnica de Valencia, Camino de Vera S/N, 46022 Valencia, Spain

Received 26 April 2006; received in revised form 26 September 2006; accepted 3 October 2006

Available online 8 December 2006

Abstract

The problem of controlling a liquid–gas separation process is approached by using LPV control techniques. An LPV model is derived from a nonlinear model of the process using differential inclusion techniques. Once an LPV model is available, an LPV controller can be synthesized. The authors present a predictive LPV controller based on the GPC controller [Clarke D, Mohtadi C, Tuffs P. Generalized predictive control – Part I. *Automatica* 1987;23(2):137–48; Clarke D, Mohtadi C, Tuffs P. Generalized predictive control – Part II. Extensions and interpretations. *Automatica* 1987;23(2):149–60]. The resulting controller is denoted as GPC–LPV. This one shows the same structure as a general LPV controller [El Gahoui L, Scorletti G. Control of rational systems using linear-fractional representations and linear matrix inequalities. *Automatica* 1996;32(9):1273–84; Scorletti G, El Ghaoui L. Improved LMI conditions for gain scheduling and related control problems. *International Journal of Robust Nonlinear Control* 1998;8:845–77; Apkarian P, Tuan HD. Parametrized LMIs in control theory. In: *Proceedings of the 37th IEEE conference on decision and control*; 1998. p. 152–7; Scherer CW. LPV control and full block multipliers. *Automatica* 2001;37:361–75], which presents a linear fractional dependence on the process signal measurements. Therefore, this controller has the ability of modifying its dynamics depending on measurements leading to a possibly nonlinear controller. That controller is designed in two steps. First, for a given steady state point is obtained a linear GPC using a linear local model of the nonlinear system around that operating point. And second, using bilinear and linear matrix inequalities (BMIs/LMIs) the remaining matrices of GPC–LPV are selected in order to achieve some closed loop properties: stability in some operation zone, norm bounding of some input/output channels, maximum settling time, maximum overshoot, etc., given some LPV model for the nonlinear system. As an application, a GPC–LPV is designed for the derived LPV model of the liquid–gas separation process. This methodology can be applied to any nonlinear system which can be embedded in an LPV system using differential inclusion techniques.
© 2006 Elsevier Ltd. All rights reserved.

Keywords: LPV controllers; LPV systems; Nonlinear systems; BMIs; LMIs; Predictive control

1. Introduction

The generalized predictive controller (GPC) originally was developed by Clarke [1,2]. This linear controller is a particular case of model based predictive controllers, which uses a controlled autoregressive integral moving average

(CARIMA) model for the process. GPC has some interesting properties [7]:

- It can be applied to unstable and nonminimum-phase processes.
- It can be used as an adaptive controller.
- It has a more complex noise model than dynamic matrix control (DMC) [8] and identification command controller (IDCOM) [9].

Moreover, it has been validated in a wide spectrum of real-life applications [10].

Starting from this point, the authors have developed a reformulation of this controller in state-space [11], since

^{*} Partially supported by projects: CICYT DPI2004-08383-C03-02 and DPI2005-07835.

^{**} This work is based on a conference paper presented at CDC'05.

^{*} Corresponding author.

E-mail address: jsalcedo@isa.upv.es (J.V. Salcedo).

URL: <http://ctl-predictivo.upv.es> (J.V. Salcedo).

the GPC of Clarke was designed using transfer functions. The result is a GPC composed by a full rank observer and a state feedback controller, which gives an output feedback GPC controller [12]:

$$\begin{aligned} \mathbf{x}^c(k+1) &= \mathbf{A}^c \mathbf{x}^c(k) + \mathbf{B}_r^c \mathbf{r}(k) + \mathbf{B}_y^c \mathbf{y}(k), \\ \mathbf{u}(k) &= \mathbf{C}^c \mathbf{x}^c(k) + \mathbf{D}_r^c \mathbf{r}(k) + \mathbf{D}_y^c \mathbf{y}(k), \end{aligned} \quad (1)$$

being \mathbf{y} the output vector of size n , \mathbf{r} the reference vector, \mathbf{u} the control action vector of size m , and \mathbf{x}^c the controller state vector of size n_c .

1.1. Matrix inequalities

A linear matrix inequality (LMI) is an expression of the form [13,14]:

$$\mathbf{F}(\mathbf{x}) \triangleq \mathbf{F}_0 + \sum_{i=1}^m x_i \mathbf{F}_i > 0, \quad (2)$$

where $\mathbf{x} \in \mathbb{R}^m$ is the unknowns vector and the symmetric matrices $\mathbf{F}_i = \mathbf{F}_i^T \in \mathbb{R}^{n \times n}$, $i = 0, \dots, m$ are given. The inequality symbol $>$ means that $\mathbf{F}(\mathbf{x})$ is a positive definite matrix. By definition, the previous LMI is strict, although it is possible to consider nonstrict LMIs using \geq instead of $>$. A bilinear matrix inequality is a generalization of an LMI incorporating products between unknowns:

$$\mathbf{F}(\mathbf{x}) \triangleq \mathbf{F}_0 + \sum_{i=1}^m x_i \mathbf{F}_i + \sum_{i=1}^m \sum_{j=1}^m x_i x_j \mathbf{F}_{i,j} > 0. \quad (3)$$

Following these lines, a nonlinear matrix inequality (NMI) is a matrix inequality where the dependence with respect to unknowns is a general nonlinear function. A special case that frequently occurs in practice consists of a polynomial dependence, which gives polynomial matrix inequalities (PMI).

1.2. LPV controllers

For last years many authors [3–6,15–20] have developed linear parameter varying (LPV) controllers for nonlinear systems. The key idea consists in modifying the controller matrices to adapt the controller to the nonlinear system depending on signal measurements. The most general dependence of controller matrices with respect to measurements is linear fractional (LF) [3], and in particular for discrete-time systems the controller structure is [21]:

$$\begin{pmatrix} \mathbf{x}^c(k+1) \\ \mathbf{y}_\Delta^c(k) \\ \mathbf{u}(k) \end{pmatrix} = \underbrace{\begin{pmatrix} \mathbf{A}^c & \mathbf{B}_\Delta^c & \mathbf{B}_r^c & \mathbf{B}_y^c \\ \mathbf{C}_\Delta^c & \mathbf{D}_\Delta^c & \mathbf{D}_{\Delta,r}^c & \mathbf{D}_{\Delta,y}^c \\ \mathbf{C}^c & \mathbf{D}_{u,\Delta}^c & \mathbf{D}_r^c & \mathbf{D}_y^c \end{pmatrix}}_{\mathbf{K}(z)} \begin{pmatrix} \mathbf{x}^c(k) \\ \mathbf{u}_\Delta^c(k) \\ \mathbf{r}(k) \\ \mathbf{y}(k) \end{pmatrix}, \quad (4)$$

$$\mathbf{u}_\Delta^c(k) = \Delta_m^c(k) \mathbf{y}_\Delta^c(k),$$

$\Delta_m^c(k)$ is a matrix which affinely depends on signal measurements. In Fig. 1 this structure is represented, which is

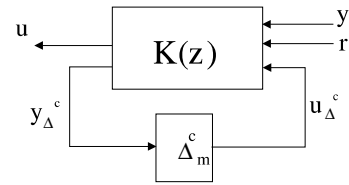


Fig. 1. Structure of a general LPV controller.

essentially composed of an upper linear fractional transformation between a linear time invariant controller and the time varying matrix Δ_m^c .

The synthesis of such controllers is based on solving a feasibility problem with LMIs and/or BMIs [13], or based on solving a linear optimization subject to LMIs and/or BMIs. The problems with LMIs are always convex and can be efficiently solved in polynomial time using, for example, interior points algorithms [13]. As opposite, the problems with BMIs are nonconvex, and there do not exist algorithms to solve them in polynomial time.

1.3. LPV models for nonlinear systems

All the references presented in the previous section require an LPV model for the nonlinear system in order to design the LPV controller. Usually the available information about a certain nonlinear system is a nonlinear model. Therefore, the first step for these methods is to obtain an LPV model whose dynamical trajectories contain the nonlinear model ones, using techniques of linear differential inclusion [13]. The key idea used in differential inclusion consists in replacing the nonlinear part of the system model by an expression which has a linear fractional (LF) dependence with respect to the signals present in this nonlinear part [3,13]. Other references obtain a identified LPV model [19,20,22–27] using an experimental data or a given nonlinear model for the nonlinear system.

The result of this operation is a linear time varying model which depends LF on that signals, as Fig. 2 shows. In particular, its mathematical representation is:

$$\begin{pmatrix} \mathbf{x}(k+1) \\ \mathbf{y}_\Delta(k) \\ \mathbf{e}(k) \\ \mathbf{y}(k) \end{pmatrix} = \underbrace{\begin{pmatrix} \mathbf{A} & \mathbf{B}_\Delta & \mathbf{B} & \mathbf{B}_u \\ \mathbf{C}_\Delta & \mathbf{D}_\Delta & \mathbf{D}_{\Delta,p} & \mathbf{D}_{\Delta,u} \\ \mathbf{C} & \mathbf{D}_{e,\Delta} & \mathbf{D} & \mathbf{D}_{e,u} \\ \mathbf{C}_y & \mathbf{D}_{y,\Delta} & \mathbf{D}_{y,p} & \mathbf{D}_{y,u} \end{pmatrix}}_{\mathbf{M}(z)} \begin{pmatrix} \mathbf{x}(k) \\ \mathbf{u}_\Delta(k) \\ \mathbf{p}(k) \\ \mathbf{u}(k) \end{pmatrix}, \quad (5)$$

$$\mathbf{u}_\Delta(k) = \Delta(k) \mathbf{y}_\Delta(k),$$

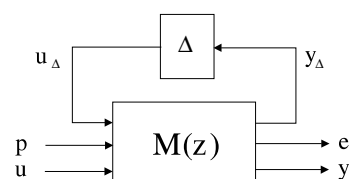


Fig. 2. Structure of the linear time varying model.

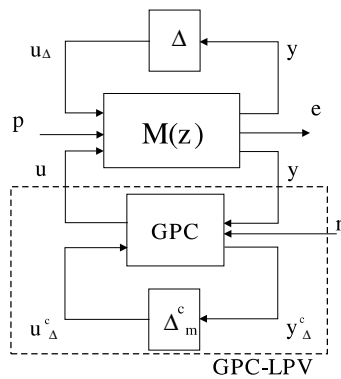


Fig. 3. Structure of GPC-LPV.

where Δ depends affinely on some system signals, \mathbf{p} is a vector containing any input signal different from control actions, and \mathbf{e} is a vector containing all the output signals which can give a system performance measure.

This linear time varying system can be viewed as a linear parameter varying one since the signals present in Δ can be interpreted as parameters that are time varying. Therefore, this is an LPV model for the nonlinear system.

In general, not all the signals present in Δ will be measurable, and so the LPV controllers designed for this LPV model only will can use measured ones Δ_m :

$$\Delta = \begin{pmatrix} \Delta_m & \mathbf{0} \\ \mathbf{0} & \Delta_{nm} \end{pmatrix}, \quad (6)$$

and so, Δ_m^c only will depend on Δ_m .

In these cases the designed LPV controllers are called robust, since, at least, they must stabilize the LPV model with time varying parameters that cannot be measured on line.

2. GPC-LPV

The GPC-LPV controller is an LPV controller based on the linear state-space GPC (1) presented in Section 1. The key idea consists in adding to a designed GPC a linear fractional dependence with respect the signals present in the matrix Δ_m , and therefore, this gives the LPV controller¹ (4) (Fig. 3), but in this particular case the matrices A^c , B_r^c , B_y^c , C^c , D_r^c and D_y^c are known since the linear GPC is designed in a first step. The remaining matrices must be designed in a second step: B_Δ^c , C_Δ^c , D_Δ^c , $D_{\Delta,r}^c$, $D_{\Delta,y}^c$ and $D_{u,\Delta}^c$, which can be referred as delta matrices.

The initial linear GPC is designed by using a linear local model of the LPV model around an operating point, which belongs to the nonlinear system operation zone. This local model is obtained from LPV model assuming the signals of matrix Δ a constant and equal to the signal values at that operating point. The LTI GPC has a number of integrators equal to the number of output controlled signals.

The second step of the design consists in obtaining the delta matrices. However, there is a initial problem which must be solved: the resulting GPC-LPV may not have, in general, the integral behaviour of LTI GPC. The state matrix of GPC-LPV (4) is:

$$A^c + B_\Delta^c \Delta_m^c (I - D_\Delta^c \Delta_m^c)^{-1} C_\Delta^c. \quad (7)$$

It must be assured that this matrix has exactly a number of eigenvalues at one equal to the number of controlled outputs. By design, A^c satisfies this condition, and so there exists a linear state transformation T such that:

$$T^{-1} A^c T = \begin{pmatrix} A^{c'} & Z \\ \mathbf{0} & I_n \end{pmatrix}, \quad (8)$$

using this transformation in (7) the number of integrators will be exactly n if:

$$\begin{pmatrix} A^{c'} & Z \\ \mathbf{0} & I_n \end{pmatrix} + \begin{pmatrix} B_\Delta^{c'} \\ \mathbf{0}_{n \times n_{\Delta_m^c}} \end{pmatrix} \Delta_m^c (I - D_\Delta^c \Delta_m^c)^{-1} C_\Delta^c, \quad (9)$$

where $n_{\Delta_m^c}$ is the size of Δ_m^c , and some of the delta matrices have changed to new values as a result of this linear transformation: $B_\Delta^{c'}$ and $C_\Delta^{c'}$. Besides, some matrices of LTI GPC have also changed by this transformation: $B_r^{c'}$, $B_y^{c'}$ and $C^{c'}$.

The design of delta matrices is done by solving feasibility problems with LMIs and/or BMIs, or optimizing linear functions subject to LMIs and/or BMIs. These matrix inequalities were obtained starting from previous results found in the literature, usually for continuous-time systems, and adapting them to the particular case of GPC-LPV. The resulting controller at off-nominal points verifies all the specifications demanded:² stability, norm bounding, etc.; since delta matrices are obtained satisfying the corresponding matrix inequalities for all the possible values of Δ matrix.

2.1. Matrix inequalities conditions for closed loop stability

The main result which enables the most part of matrix inequalities obtained in the last years is the Lyapunov condition of stability. If it exists a positive definite matrix Q such that:

$$A^T Q A - Q < 0, \quad (10)$$

then the linear autonomous system $\mathbf{x}(k+1) = A\mathbf{x}(k)$ is asymptotically stable. This condition is used in [6,13,28–31]. The main difference between these results consists of the dependence with respect to matrix Δ : affine, quadratic or LF. In this work the authors have used the most general dependence, that is to say, LF.

Following, mainly, the ideas of [6,31] it is possible to obtain a set of LMIs and a PMI which provides a sufficient condition for the stability of the closed loop formed by GPC-LPV and the LPV model (5):

¹ This controller is LPV since its state-space matrices depends LF on measurable time-varying parameters Δ_m .

² Below presented.

$$\begin{pmatrix} * \\ * \\ * \\ * \end{pmatrix}^T \left(\begin{array}{c|c} -Q & 0 \\ \hline 0 & Q \\ \hline 0 & V \end{array} \right) \begin{pmatrix} I & 0 \\ A_{CL} & B_{CL,\Delta} \\ 0 & I \\ C_{CL,\Delta} & D_{CL,\Delta} \end{pmatrix} < 0, \quad (11)$$

$$\begin{aligned} A_{CL} &= \begin{pmatrix} A + B_y D_y^c C_u & B_u C^c \\ B_y^c C_y & \begin{pmatrix} A^c & Z \\ 0 & I_n \end{pmatrix} \end{pmatrix}, \\ B_{CL,\Delta} &= \begin{pmatrix} B_\Delta + B_u D_y^c D_{y,\Delta} & B_u D_{u,\Delta}^c \\ B_y^c D_{y,\Delta} & \begin{pmatrix} B_\Delta^c \\ 0_{n \times n_{\Delta_m^c}} \end{pmatrix} \end{pmatrix}, \\ C_{CL,\Delta} &= \begin{pmatrix} C_\Delta + D_{\Delta,u} D_y^c C_y & D_{\Delta,u} C^c \\ D_{\Delta,y}^c C_y & C_\Delta^c \end{pmatrix}, \\ D_{CL,\Delta} &= \begin{pmatrix} D_\Delta + D_{\Delta,u} D_y^c D_{y,\Delta} & D_{\Delta,u} D_{u,\Delta}^c \\ D_{\Delta,y}^c D_{y,\Delta} & D_\Delta^c \end{pmatrix}, \\ \begin{pmatrix} \bar{\Delta} \\ I \end{pmatrix}^T \begin{pmatrix} V_{11} & V_{12} \\ V_{21} & V_{22} \end{pmatrix} \begin{pmatrix} \bar{\Delta} \\ I \end{pmatrix} &> 0, \\ V &= \begin{pmatrix} V_{11} & V_{12} \\ V_{21} & V_{22} \end{pmatrix}, \quad V_{11} < 0, \\ \forall \bar{\Delta}, \quad \bar{\Delta} &= \text{diag}(\Delta, \Delta_m^c). \end{aligned} \quad (12)$$

Eq. (11) is a PMI since there are products of three variables. This condition is sufficient due to the characteristic complexity of LF dependence [31], and by the use of a constant Lyapunov matrix Q , which does not depend on matrix $\bar{\Delta}$. It is possible to override the second limitation by using a parameter dependent Lyapunov matrix, although this extreme provides a PMI much more complex, and so with more computational complexity.

The selection of matrix Δ_m^c in terms of Δ_m can be made arbitrarily complex by taking an LF dependence:

$$\Delta_m^c = \Delta_M^c + \Delta_L^c \Delta_m (I - \Delta_D^c \Delta_m) \Delta_R^c, \quad (13)$$

where Δ_M^c , Δ_L^c , Δ_D^c and Δ_R^c are unknown matrices. As a particular case, it is possible to take $\Delta_m^c = \Delta_m$ providing a simpler and more conservative condition.

PMI (11) can be recast as a BMI by using Schur complement lemma [13] and adding the condition $V_{22} > 0$:

$$\begin{pmatrix} M^T \begin{pmatrix} -Q & 0 \\ 0 & Q \\ 0 & V \end{pmatrix} M - M_1^T \begin{pmatrix} Q & 0 \\ 0 & V_{22} \end{pmatrix} M_1 \\ -M_1^T \begin{pmatrix} Q & 0 \\ 0 & V_{22} \end{pmatrix} M_1 \\ \begin{pmatrix} Q & 0 \\ 0 & V_{22} \end{pmatrix} M_1 & - \begin{pmatrix} Q & 0 \\ 0 & V_{22} \end{pmatrix} \end{pmatrix} < 0, \\ M &= \begin{pmatrix} I & 0 \\ A_{CL} & B_{CL,\Delta} \\ 0 & I \\ C_{CL,\Delta} & D_{CL,\Delta} \end{pmatrix}, \quad M_1 = \begin{pmatrix} 0 & B_{CL,\Delta} \\ C_{CL,\Delta} & D_{CL,\Delta} \end{pmatrix}. \quad (14)$$

2.2. Matrix inequalities conditions for norm bounding

In the literature there are also conditions to ensure bounds for different norms: ∞ , 2 and 1. For ∞ -norm it is applied, for example, the *bounded real lemma* [32], for 2-norm the grammians can be used [33], and for 1-norm the star norm (*-norm) which is an upper bound [34,35] can be recast as matrix inequalities.

Following the same lines as previous subsection the authors have developed BMIs for these three norms by using LF dependence. For example, a sufficient condition that ensures that ∞ -norm of channel p/e is bounded by $\gamma > 0$ is:

$$\begin{aligned} & \left(L^T \begin{pmatrix} -Q & 0 & 0 \\ 0 & Q & 0 \\ 0 & 0 & -\gamma^2 I_m \end{pmatrix} L - L_1^T \begin{pmatrix} Q & 0 & 0 \\ 0 & I_r & 0 \\ 0 & 0 & V_{22} \end{pmatrix} L_1 - L_1^T \begin{pmatrix} Q & 0 & 0 \\ 0 & I_r & 0 \\ 0 & 0 & V_{22} \end{pmatrix} \right) < 0, \\ & \left(\begin{pmatrix} Q & 0 & 0 \\ 0 & I_r & 0 \\ 0 & 0 & V_{22} \end{pmatrix} L_1 - \begin{pmatrix} Q & 0 & 0 \\ 0 & I_r & 0 \\ 0 & 0 & V_{22} \end{pmatrix} \right) \\ & L = \begin{pmatrix} I & 0 & 0 \\ A_{CL} & B_{CL,p} & B_{CL,\Delta} \\ 0 & I & 0 \\ C_{CL,e} & D_{CL,pe} & D_{CL,e\Delta} \\ 0 & 0 & I \end{pmatrix}, \quad L_1 = \begin{pmatrix} 0 & 0 & B_{CL,\Delta} \\ 0 & 0 & D_{CL,e\Delta} \\ C_{CL,\Delta} & D_{CL,\Delta p} & D_{CL,\Delta} \end{pmatrix}, \\ & B_{CL,p} = \begin{pmatrix} B + B_u D_y^c D_{y,p} \\ B_y^c D_{y,p} \end{pmatrix}, \quad C_{CL,e} = (C + D_{e,u} D_y^c C_y \quad D_{e,u} C^c), \\ & D_{CL,pe} = D + D_{e,u} D_y^c D_{y,p}, \\ & D_{CL,e\Delta} = D_{e,\Delta} + D_{e,u} D_y^c D_{y,\Delta}, \quad D_{CL,\Delta p} = \begin{pmatrix} D_{\Delta,p} + D_{\Delta,u} D_y^c D_{y,p} \\ D_{\Delta,y}^c D_{y,p} \end{pmatrix}. \end{aligned} \quad (15)$$

2.3. Matrix inequalities conditions for closed loop specifications

Specifications such as settling time, overshoot, etc., can be guaranteed by using sufficient conditions based on BMIs and LMIs [32,36]. Basically, the procedure is the same as in previous sections, although in this case the matrix inequalities are developed by employing closed loop pole clustering techniques. For example, Lyapunov stability condition for discrete-time systems imposes pole clustering on the open unit disk. Pole clustering in other complex plane subsets guarantees other specifications, for example:

- Maximum settling time: disk centered at origin with radius smaller than one.
- Maximum transient oscillation frequency ω_p : sector with vertex at the origin and angle $\omega_p \cdot T$, being T the sampling period.

For these and other more complex subsets BMIs and/or LMIs sufficient conditions for pole clustering of closed loop poles are developed. They are omitted due to limited space.

2.4. Other matrix inequalities conditions

It is possible to obtain sufficient conditions in order to guarantee other properties:

- Time domain constraint satisfaction: saturation of actuators, safety limits in some signals, etc.
- Generalized 2-norm [33].
- etc.

2.5. Analysis of matrix inequalities conditions

In all the matrix inequalities obtained previously for the GPC–LPV (14) and (15), there is at least one BMI,³ being the remaining ones LMIs. These BMIs can not be recast as LMIs, and so the design of GPC–LPV controller presented here requires an algorithm capable of deal with kind of matrix inequalities.

2.6. Numerical resolution of problems with BMIs

As previously stated, for problems with LMIs there are efficient algorithms that obtain the solution in polynomial time. However, the problems with BMIs [37]:

- In the actual literature of robust control based on matrix inequalities they have a great importance [38,39].
- They can be NP-hard problems [40].
- They are nonconvex and so may exist local solutions that can be considered as suboptimal one.
- There do not exist, in general, algorithms which can obtain in polynomial time their global solution.
- There exist algorithms based on branch and bound techniques which can solve problems of small size (low number of variables and small BMIs) in exponential time [38,39,41,42].
- By other side, there exist algorithms that obtain only local solutions but they can solve problems of medium and large size [43–45].

The algorithm proposed in [45] has been implemented in the commercial software *PENBMI* from *PENOPT*.⁴ *PENBMI* has been used in this work to obtain local solutions to the problems with BMIs. The main reason to use this software is that the BMI problems presented in this work have large size. In particular this software can be used in Matlab through the free toolbox *YALMIP*.⁵

3. Application: liquid–gas separation process

In this section the previous design methodology of GPC–LPV controller will be applied to a liquid–gas separation process (Fig. 4), extensively used in petrol engineering to vaporize liquable gases, which in this example consists of liquid propane. The system nonlinear model has been taken from [46,47]:

$$\begin{aligned} \dot{V}_L &= F_o - \frac{K}{\rho} \left(\frac{e^{A_1/T+A_2}}{T} \cdot T - \frac{RT}{M} \cdot \rho_v \right), \\ \dot{T} &= \frac{1}{V_L} \left[F_o(T_o - T) + \frac{Q}{\rho C_p} - \frac{K \lambda_v}{\rho C_p} \left(\frac{e^{A_1/T+A_2}}{T} \cdot T - \frac{RT}{M} \cdot \rho_v \right) \right], \\ \dot{\rho}_v &= \frac{1}{V - V_L} \left[\rho_v(F_o - F_v) \right. \\ &\quad \left. + K \left(1 - \frac{\rho_v}{\rho} \right) \left(\frac{e^{A_1/T+A_2}}{T} \cdot T - \frac{RT}{M} \cdot \rho_v \right) \right], \end{aligned} \quad (16)$$

In this state-space model the state variables are: T (°C) gas temperature equal to liquid temperature, V_L (m³) liquid volume and ρ_v (kg/m³) gas density. Input signals: F_o (m³/s) liquid propane flow, Q (kcal/s) heat power that provides the intercooler and F_v (m³/s) the upper extraction flow, which is constant and equal to 0.105 m³/s. This model supposes that liquid density is constant and equal to $\rho = 500$ kg/m³. The remaining signals are considered to be constant and their values and the model constant values are shown in Table 1.

Table 1
Liquid–gas separator physics parameters

Name	Description	Value
V	Separator volume	3.14 m ³
T_o	Input flow temperature	323 K
λ_v	Vaporization heat	75 kcal/kg
C_p	Liquid heat capacity at constant pressure	0.6 kcal/(kg K)
A_1		−2359
A_2		10.165
R	Perfect gases constant	2 kcal/(K kmol)
M	Propane molecular mass	44 kg/kmol
K	Vaporization constant	2.7554×10^{-5} kg/(s Pa)

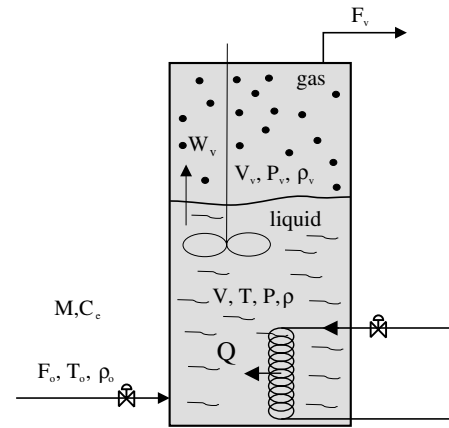


Fig. 4. Liquid–gas separation process.

³ Also true for many other conditions.

⁴ www.penopt.com.

⁵ http://control.ee.ethz.ch/joloef/yalmip.php.

Next step is to sample this nonlinear model (16) by using a zero order hold (ZOH) with sampling period T_s taking a first order approximation of matrix exponential [48]:

$$A_d = e^{A T_s} \approx I + A \cdot T_s, \quad (17)$$

since with $T_s = 0.5$ s the approximate discrete matrix is a good estimate of exact one. With such approximation the discrete-time model is:

$$\begin{pmatrix} V_L(k+1) \\ T(k+1) \\ \rho_v(k+1) \end{pmatrix} = A_d \begin{pmatrix} V_L(k) \\ T(k) \\ \rho_v(k) \end{pmatrix} + B_d \begin{pmatrix} F_o(k) \\ Q(k) \end{pmatrix},$$

$$A_d = T_s \begin{pmatrix} \frac{1}{T_s} & -\frac{K}{\rho} \frac{e^{A_1/T+A_2}}{T} & \frac{KRT}{\rho M} \\ 0 & \frac{1}{T_s} - \frac{K\lambda_v}{\rho C_p} \frac{e^{A_1/T+A_2}}{T} & \frac{K\lambda_v RT}{\rho C_p M} \frac{1}{V_L} \\ 0 & \psi \frac{e^{A_1/T+A_2}}{T} & \frac{1}{T_s} - \frac{1}{V-V_L} F_v - \psi \frac{RT}{M} \end{pmatrix},$$

$$\psi = \frac{1}{V-V_L} K \left(1 - \frac{\rho_v}{\rho} \right),$$

$$B_d = \begin{pmatrix} T_s & 0 \\ \frac{1}{V_L} (T_o - T) \cdot T_s & \frac{1}{\rho C_p V_L} \cdot T_s \\ \frac{\rho_v}{V-V_L} \cdot T_s & 0 \end{pmatrix}.$$

As it can be seen, A_d and B_d matrices depend nonlinearly on state variables, so all of them must be included in time varying parameters such that an LPV model can be obtained:

$$\delta_1 = 1/V_L, \quad \delta_2 = T - T_o, \quad \delta_3 = \rho_v. \quad (19)$$

This selection of time varying parameters is justified by the form how the LPV model is obtained [3,49]. The obtaining of this LPV model is omitted due to its large extension.

By other side, as it is present an exponential dependence with respect temperature in A_d it is necessary to use a Taylor series of degree 2 in order to obtain an LF dependence:

$$e^{A_1/T+A_2} \approx a_0 + a_1 \cdot (T - T_o) + a_2 \cdot (T - T_o)^2 \quad (20)$$

with this series a good adjust is obtained along the temperature operation range. Finally, taking V_L and T as measured output signals the resulting LPV model is:

$$\begin{pmatrix} x(k+1) \\ y_\Delta \\ y \end{pmatrix} = \begin{pmatrix} A & B_\Delta & B_u \\ C_\Delta & D_\Delta & D_{\Delta,u} \\ C_y & D_{y,\Delta} & D_{y,u} \end{pmatrix} \begin{pmatrix} x(k) \\ u_\Delta \\ u(k) \end{pmatrix} u_\Delta$$

$$= \Delta(k) y_\Delta, \Delta(k)$$

$$= \text{Diag}(\delta_1(k) I_2, \delta_2(k), \delta_3(k), \delta_2(k) I_4) \quad (21)$$

$$A = \begin{pmatrix} 1 & -\frac{K a_0 T_s}{\rho T_o} & \frac{KRT_s T_o}{\rho M} \\ 0 & 1 & 0 \\ 0 & 0 & 1 \end{pmatrix},$$

$$B_\Delta = \begin{pmatrix} 0 & 0 & 0 & 0 & \frac{KRT_s}{\rho M} & \frac{KT_s}{\rho T_o} & -\frac{K a_2 T_s}{\rho T_o} & -\frac{K a_1 T_s}{\rho T_o} \\ 1 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & -1 & 0 & 0 & 0 & 0 & 0 & 0 \end{pmatrix},$$

$$B_u = \begin{pmatrix} T_s & 0 \\ 0 & 0 \\ 0 & 0 \end{pmatrix}, \quad C_\Delta = \begin{pmatrix} 0 & -\frac{K\lambda_v a_0 T_s}{\rho C_p T_o} & \frac{K\lambda_v RT_s T_o}{\rho C_p M} \\ 0 & \frac{K a_0 T_s}{T_o} & -F_v T_s - \frac{KRT_s T_o}{M} \\ 0 & 0 & 0 \\ 0 & -\frac{K a_0 T_s}{\rho T_o} & \frac{KRT_s T_o}{\rho M} \\ 0 & 0 & 1 \\ 0 & a_0/T_o & 0 \\ 0 & 0 & 0 \\ 0 & 1 & 0 \end{pmatrix},$$

$$D_\Delta = \begin{pmatrix} 0 & 0 & 1 & 0 & \frac{K\lambda_v RT_s}{\rho C_p M} & \frac{KT_s \lambda_v}{\rho T_o C_p} & -\frac{K\lambda_v a_2 T_s}{\rho C_p T_o} & -\frac{K\lambda_v a_1 T_s}{\rho C_p T_o} \\ 0 & V & 0 & 1 & -\frac{KRT_s}{M} & -\frac{KT_s}{T_o} & \frac{KT_s a_2}{T_o} & \frac{KT_s a_1}{T_o} \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & \frac{KRT_s}{\rho M} & \frac{KT_s}{\rho T_o} & -\frac{K a_2 T_s}{\rho T_o} & -\frac{K a_1 T_s}{\rho T_o} \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \\ 0 & 0 & 0 & 0 & 0 & -1/T_o & a_2/T_o & a_1/T_o \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 1 \\ 0 & 0 & 0 & 0 & 0 & 0 & 0 & 0 \end{pmatrix},$$

$$D_{\Delta,u} = \begin{pmatrix} 0 & \frac{T_s}{\rho C_p} \\ 0 & 0 \\ -T_s & 0 \\ T_s & 0 \\ 0 & 0 \\ 0 & 0 \\ 0 & 0 \\ 0 & 0 \end{pmatrix}, \quad C_y = \begin{pmatrix} 1 & 0 & 0 \\ 0 & 1 & 0 \end{pmatrix},$$

$$D_{y,\Delta} = \mathbf{0}_{2 \times 8}, \quad D_{y,u} = \mathbf{0}_2. \quad (22)$$

The operating point for the liquid–gas separator is $T_{eq} = T_o = 323$ K and $V_{L,eq} = 1.57$ m³. Following this specification a GPC–LPV will be designed to ensure robust stability around this operating point under the condition that temperature, liquid volume and gas density lie in the ranges: $300 \text{ K} \leq T \leq 350 \text{ K}$, $0.3 \text{ V} \leq V_L \leq 0.7 \text{ V}$ and $20 \text{ kg/m}^3 \leq \rho_v \leq 30 \text{ kg/m}^3$. The real system only has sensors to measure temperature and liquid volume, and so the GPC–LPV only will be able to use both measures in Δ_m^c :

$$\Delta_m^c(k) = f(\delta_1(k), \delta_2(k)). \quad (23)$$

In particular, the easiest dependence was used:

$$\Delta_m^c(k) = \begin{pmatrix} \delta_1(k) & 0 \\ 0 & \delta_2(k) \end{pmatrix}. \quad (24)$$

As it is known, in a first step an LTI GPC is designed by using the linear local model corresponding to the operating point of liquid–gas separator. In this design the selected parameters were:

- $N_1 = 1, N_2 = 120, N_u = 1$.
- $Q_i = \begin{pmatrix} 1 & 0 \\ 0 & 2 \end{pmatrix}, R_i = \begin{pmatrix} 1.5 & 0 \\ 0 & 0.01 \end{pmatrix} \forall i$.
- Observer poles. For first output: 0.4, 0.5, 0.7 and 0.8. For second output: 0.2, 0.4 and 0.7.

These parameters were adjusted manually after different experiments over the separator, which guarantee closed loop stability inside the operating ranges, by using LMIs conditions.

In Figs. 5–8 temperature, liquid volume, F_o flow and heat power are represented when the LTI GPC controls the separator, under the assumption that this one starts from the equilibrium point given by $T = 340$ K and $V_L = 1.9$ m³.

In a second step, the delta matrices of GPC–LPV are designed under the condition that ∞ -norm of channel r/u is smaller than LTI GPC one. This design is based on the BMI (15). The optimization with PENBMI took around 30 m in a PENTIUM IV at 2.8 GHz with 512 MB of RAM under Windows XP. After the calculation, the LTI GPC provides an ∞ -norm of 514.5597 whereas the GPC–LPV 392.8146. Delta matrices corresponding to GPC–LPV designed are:

$$B_{\Delta}^c = \begin{pmatrix} -1.7537 \times 10^{-2} & 3.0914 \times 10^{-3} \\ 1.6954 \times 10^{-4} & -6.6281 \times 10^{-5} \\ -1.8793 \times 10^{-5} & 3.9026 \times 10^{-6} \\ -5.1626 \times 10^{-5} & 4.7361 \times 10^{-6} \\ -1.2388 \times 10^{-5} & -7.6908 \times 10^{-8} \\ 4.1258 \times 10^{-7} & -1.9465 \times 10^{-7} \\ -5.2850 \times 10^{-7} & 6.9737 \times 10^{-8} \end{pmatrix},$$

$$C_{\Delta}^c = \begin{pmatrix} 2.5626 & -0.5310 \\ 20.1832 & -21.4447 \\ -72.2428 & -181.1467 \\ 118.1280 & 353.9015 \\ -54.0962 & -365.9777 \\ -111.2757 & -68.8352 \\ -14.0149 & -57.4931 \\ -11.8806 & -42.3621 \\ 211.3161 & 36.0944 \end{pmatrix},$$

$$D_{\Delta}^c = \begin{pmatrix} -0.4583 & 0.0298 \\ 0.0573 & 0.0185 \end{pmatrix},$$

$$D_{\Delta,y}^c = \begin{pmatrix} 125.5063 & -26.0878 \\ 300.6801 & -3.8997 \end{pmatrix},$$

$$D_{\Delta,r}^c = \begin{pmatrix} -55.2494 & -11.6330 \\ -3.1525 & 0.8039 \end{pmatrix}, \quad D_{u,\Delta}^c = \mathbf{0}_2.$$

In the aforementioned figures the results obtained with GPC–LPV are also represented. Basically, the GPC–LPV provides a faster closed loop response and a bigger undershoot in temperature.

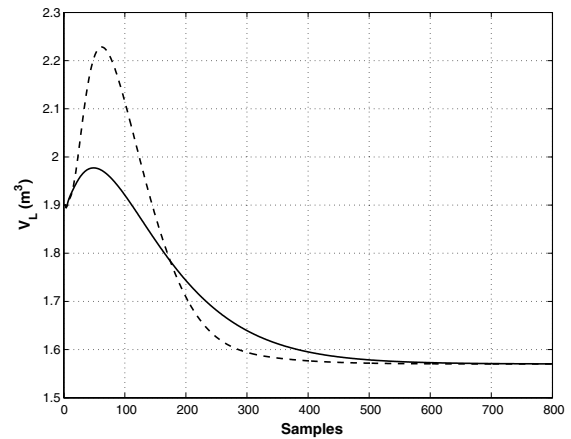


Fig. 5. Liquid volume. Continuous line: LTI GPC. Dashed line: GPC–LPV.

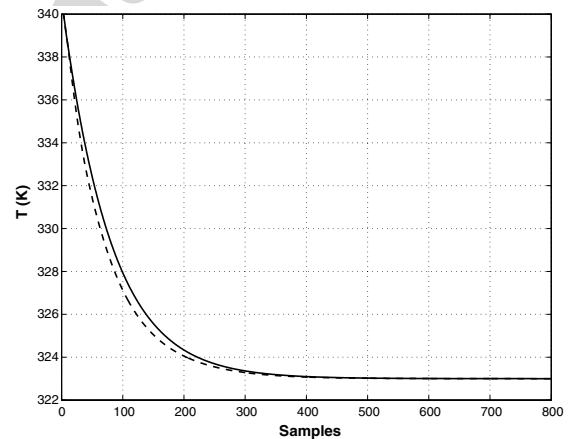


Fig. 6. Temperature. Continuous line: LTI GPC. Dashed line: GPC–LPV.

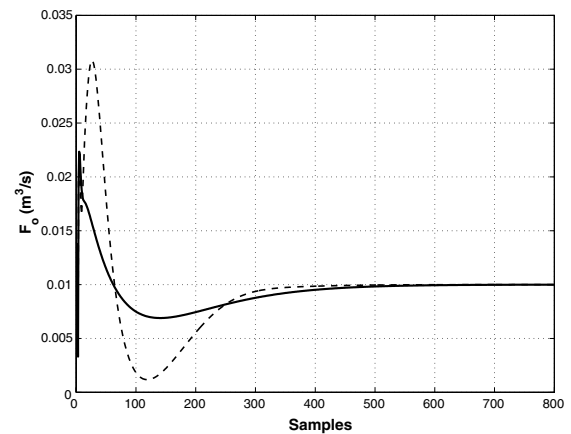


Fig. 7. Liquid propane flow. Continuous line: LTI GPC. Dashed line: GPC–LPV.

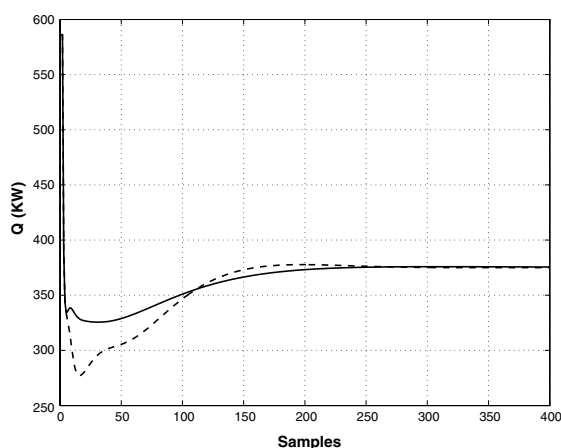


Fig. 8. Heat power. Continuous line: LTI GPC. Dashed line: GPC-LPV.

4. Conclusions

- The GPC-LPV controller is presented as an LPV controller designed in two steps.
- In first step an LTI GPC is designed by using a local model of the nonlinear system.
- In a second step delta matrices are selected in order to satisfy a set of LMIs and or BMIs, which guarantees: closed loop stability, norm bounding, closed loop specifications, etc.
- The set of LMIs and or BMIs is obtained starting from the results of analyzed literature, and working with the matrix inequalities in this particular case.
- Along this work the dependence with respect to Δ matrix is always LF.
- In most cases BMIs are obtained from PMIs by applying the *Schur lemma*.
- For the numerical computation of solutions, the commercial software *PENBMI* is used to obtain local solutions.
- The design methodology of GPC-LPV is applied to a highly nonlinear model of a liquid-gas separator process.

References

- [1] Clarke D, Mohtadi C, Tuffs P. Generalized predictive control – Part I. *Automatica* 1987;23(2):137–48.
- [2] Clarke D, Mohtadi C, Tuffs P. Generalized predictive control – Part II. Extensions and interpretations. *Automatica* 1987;23(2):149–60.
- [3] El Ghaoui L, Scorletti G. Control of rational systems using linear-fractional representations and linear matrix inequalities. *Automatica* 1996;32(9):1273–84.
- [4] Scorletti G, El Ghaoui L. Improved LMI conditions for gain scheduling and related control problems. *International Journal of Robust and Nonlinear Control* 1998;8:845–77.
- [5] Apkarian P, Tuan HD. Parametrized LMIs in control theory. In: *Proceedings of the 37th IEEE conference on decision and control*; 1998. p. 152–7.
- [6] Scherer CW. LPV control and full block multipliers. *Automatica* 2001;37:361–75.
- [7] Clarke D, Mohtadi C. Properties of generalized predictive control. *Automatica* 1989;25(6):859–75.
- [8] Cutler C, Ramaker D. Dynamic matrix control – a computer control algorithm. *Automatic Control Conference Proceeding*. CA: San Francisco; 1980.
- [9] Richalet J, Rault A, Testud JL, Papon J. Model predictive heuristic control: applications to industrial processes. *Automatica* 1978;14:413–28.
- [10] Bitmead R, Gevers M, Wertz V. *Adaptive optimal control: the thinking man's GPC*. Prentice Hall; 1990.
- [11] Salcedo JV, Martínez M, Sanchis J, Blasco X. Design of GPC's in state space. *Automatika* 2002;42(3–4):159–67.
- [12] Salcedo JV, Martínez M, Sanchis J, Blasco FX. GPC design with guaranteed feasibility under hard constraints. In: *XI Congreso Latinoamericano de Control Automático*; 2004 [in Spanish].
- [13] Boyd S, El Ghaoui L, Feron E, Balakrishnan V. *Linear matrix inequalities in system and control theory*, vol. 15 ed. Philadelphia: SIAM Studies in Applied Mathematics; 1994.
- [14] Chen CW. Stability conditions of fuzzy systems and its application to structural mechanical systems. *Adv Eng Software*, in press.
- [15] Becker G, Packard A. Robust performance of linear parametrically varying systems using parametrically dependent linear feedback. *Systems and Control Letters* 1994;23:205–15.
- [16] Packard A. Gain Scheduling via linear fractional transformations. *Systems and Control Letters* 1994;22:79–92.
- [17] Helmersson A. *Methods for robust gain scheduling*. Ph.D. thesis, Linköping University, Linköping, Sweden; 1995.
- [18] Wang F, Balakrishnan V. Improved stability analysis and gain-scheduled controller synthesis for parameter-dependent systems. *IEEE Transactions on Automatic Control* 2002;47(5):720–34.
- [19] Wassink MG, Van de Val C, Scherer M, Bosgra O. LPV control for a water stage: beyond the theoretical solution. *Control Engineering Practice* 2005;13:231–45.
- [20] Giarre L, Bauso D, Falugi P, Bamieh B. LPV model identification for gain scheduling control: an application to rotating stall and surge control problem. *Control Engineering Practice* 2006;14:351–61.
- [21] Apkarian P, Pellanda PC, Tuan HD. Mixed H_2/H_∞ multichannel linear parameter-varying control in discrete time. *Systems and Control Letters* 2000;41:333–46.
- [22] Nemani M, Ravikanth R, Bamieh BA. Identification of linear parametrically varying systems. In: *Proceedings of the 34th conference on decision and control*; 1995. p. 2990–5.
- [23] Bodenheimer B, Bendotti P, Kanter M. Linear parameter-varying control of a ducted fan engine. *International Journal of Robust and Nonlinear Control* 1996;6(9–10):1023–44.
- [24] Lee YI, Kouvaritakis B. Stabilizable regions of receding horizon predictive control with input constraints. *Systems and Control Letters* 1999;38:13–20.
- [25] Verdult V, Verhaegen M. Subspace identification of multivariable linear parameter-varying systems. *Automatica* 2002;38:805–14.
- [26] Bamieh B, Giarre L. Identification of linear parameter varying models. *International Journal of Robust and Nonlinear Control* 2002;12:841–53.
- [27] Sznajder M, Mazzaro MC. An LMI approach to control-oriented identification and model (In)validation of LPV systems. *IEEE Transactions on Automatic Control* 2003;48(9):1619–24.
- [28] Gahinet P, Apkarian P, Chilali M. Affine parameter-dependent Lyapunov functions and real parametric uncertainty. *IEEE Transactions on Automatic Control* 1996;41(3):436–42.
- [29] Feron E, Apkarian P, Gahinet P. Analysis and synthesis of robust control systems via parameter-dependent Lyapunov functions. *IEEE Transactions on Automatic Control* 1996;41(7):1041–6.
- [30] Oliveira MC, Bernussou J, Geromel JC. A new discrete-time robust stability condition. *Systems and Control Letters* 1999;37:261–5.
- [31] El Ghaoui L, Niculescu S, editors. *Advances in linear matrix inequality methods in control*, SIAM. *Advances in Design and Control*; 2000.

- [32] Scherer C, Weiland S. Linear matrix inequalities in control. Lecture notes of DISC Course Optimization in Control-2000; 2000.
- [33] Sanchez Peña RS, Sznaier M. Robust systems. Theory and applications. New York: John Wiley and Sons; 1998.
- [34] Abedor J, Nagpal K, Poolla K. Linear matrix inequality approach to peak-to-peak gain minimization. *International Journal of Robust and Nonlinear Control* 1996;6:899–927.
- [35] Bu J. Multi-Objective Robust Control: design of mixed l_1/H_∞ controllers, Ph.D. thesis, College of Engineering. The Pennsylvania State University; 1997.
- [36] Chiali M, Gahinet P. H_∞ design with pole placement constraints: an LMI approach. *IEEE Transactions on Automatic Control* 1996; 41(3):358–67.
- [37] VanAntwerp JG, Braatz RD. A tutorial on linear and bilinear matrix inequalities. *Journal of Process Control* 2000;10:363–85.
- [38] Tuan H, Apkarian P. Low nonconvexity-rank bilinear matrix inequalities: algorithms and applications in robust controller and structure designs. *IEEE Transactions on Automatic Control* 2000; 45(11):2111–7.
- [39] Fukuda M, Kojima M. Branch-and-cut algorithms for the bilinear matrix inequality eigenvalue problem. *Computational Optimization and Applications* 2001;19:79–105.
- [40] Toker O, Özbay H. On the NP-hardness of solving bilinear matrix inequalities and simultaneous stabilization with static output feedback. In: *Proceedings of the American control conference*; 1995.
- [41] Goh KC. Robust control synthesis via bilinear matrix inequalities, Ph.D. thesis, University of Southern California; 1995.
- [42] Goh KG, Safonov MG, Ly JH. Robust synthesis via bilinear matrix inequalities. *International Journal of Robust and Nonlinear Control* 1996;6:1079–95.
- [43] Hassibi A, How J, Boyd S. A path-following method for solving BMI problems in control. In: *Proceedings of American control conference*; 1999.
- [44] Fransson CM, Lennartson B. Low order multicriteria H_∞ design via bilinear matrix inequalities. In: *Proceedings of 42th conference on decision and control*; 2003.
- [45] Kočvara M, Stingl M. A code for convex nonlinear and semidefinite programming. *Optimization Methods and Software* 2003;8(3): 317–33.
- [46] Perez M, Berná J. Numeric-symbolic calculus with Matlab. Application to nonlinear system control using linearizing state feedback. In: *SAAEI98*; 1998 [in Spanish].
- [47] Luyben W. Process modelling, simulation and control for chemical engineers. *Chemical Engineering Series*. McGraw-Hill; 1994.
- [48] Åström KJ, Wittenmark B. Computer controlled systems. Theory and design. *Prentice Hall Information and Systems Sciences Series*; 1997.
- [49] Dussy S, El Ghaoui L. Measurement-Scheduled control for the RTAC problem. *International Journal of Robust and Nonlinear Control* 1998;8:377–400.